



NOTES

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. COORDINATE DATUM: WELLINGTON CIRCUIT 2000.
ORIGIN: MT COOK 800,000 mN 400,000 mE.
3. LEVEL DATUM: LINZ (MSL) WELLINGTON VERTICAL DATUM 1953.
4. ALL PE FITTINGS TO BE PN16 EZYLINE ELECTROFUSION MANUFACTURED BY WAVIN MONOLINE OR EQUAL APPROVED.
5. ALL PE PIPES TO BE PE100 SDR11 WITH ELECTROFUSION WELDED JOINTS.
6. SETOUT OF WORKS TO BE CONFIRMED AFTER SURVEYED SETOUT AND PRIOR TO CONSTRUCTION COMMENCEMENT.
7. REFER TO MP-06-260 FOR STORMWATER CONNECTION DETAILS AND MP-07-160 FOR WASTEWATER CONNECTION DETAILS.
8. SERVICE VALVE (MANIFOLD INCORPORATING ISOLATING VALVE, IN-LINE STRAINER, NON-TESTABLE DUAL CHECK VALVE, FLOW CONTROL RESTRICTOR AND WATER METER) AS ACUFLOW MODEL FFC900SS OR EQUAL APPROVED. MANIFOLD TO BE INSTALLED APPROX 330 BELOW GROUND LEVEL IN STANDARD WATER METER BOX WITH BLACK LID.

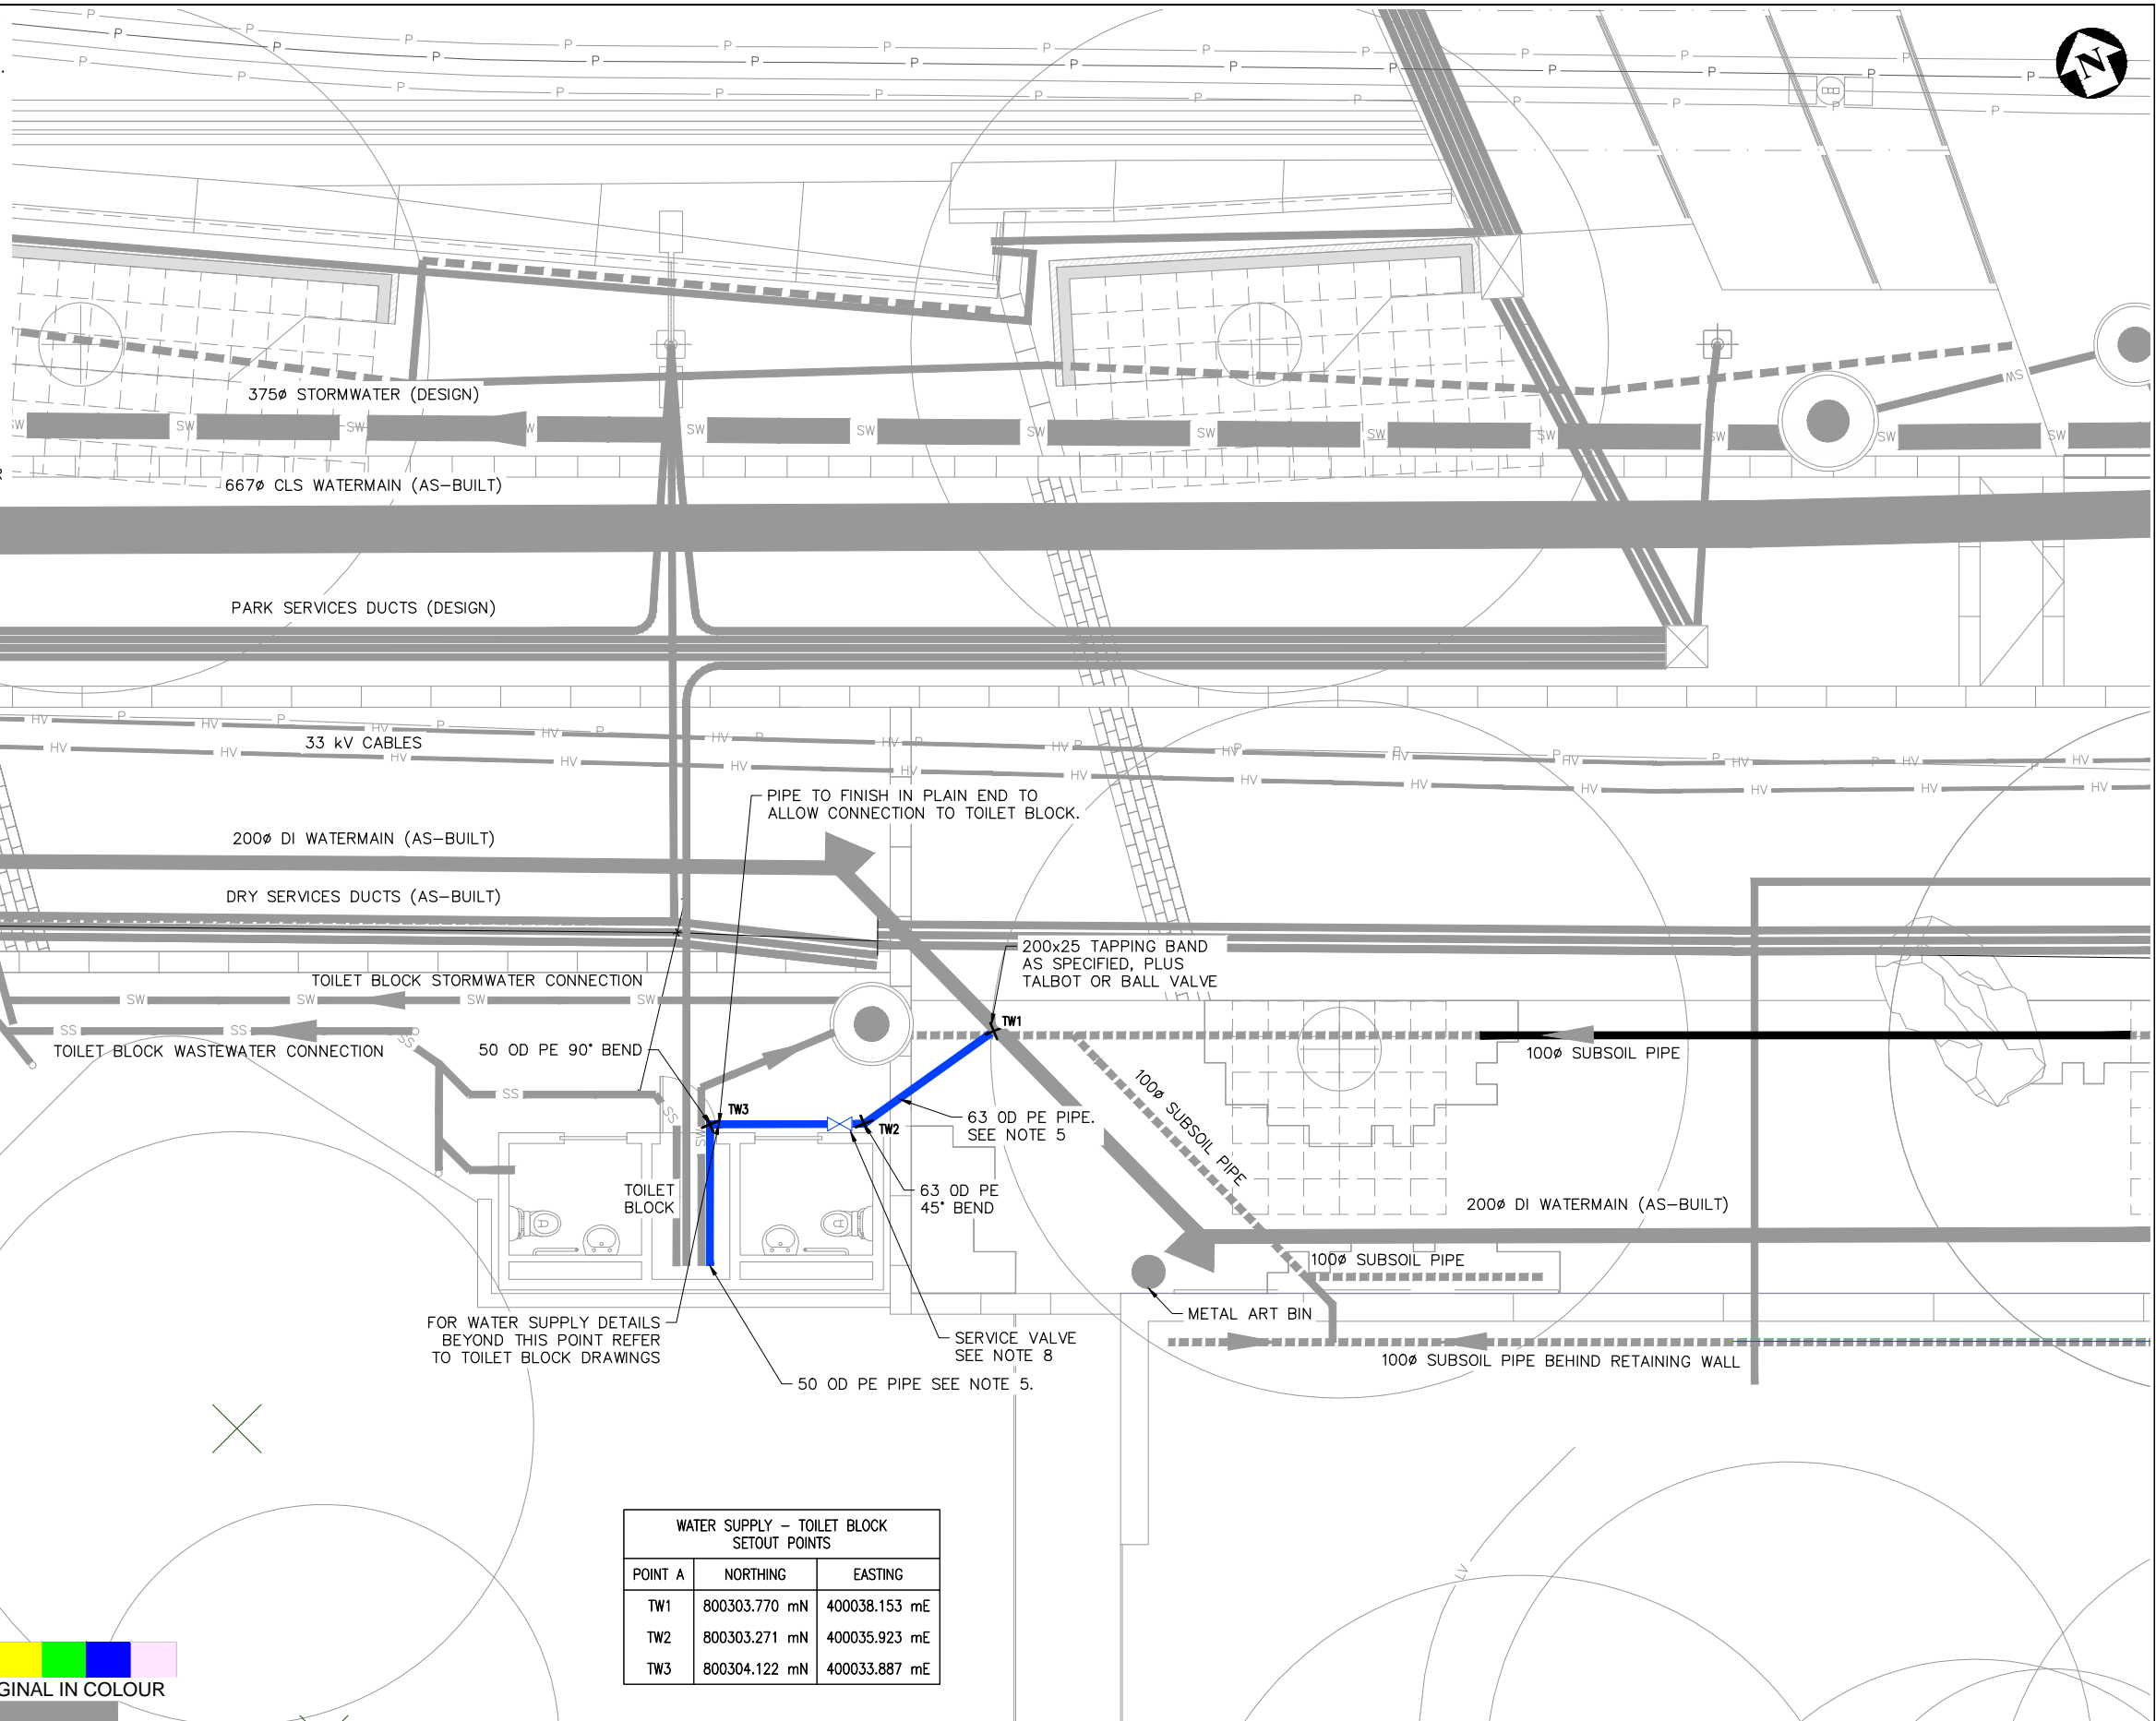

FOR WATER SUPPLY DETAILS BEYOND THIS POINT REFER TO TOILET BLOCK DRAWINGS

WATER SUPPLY - TOILET BLOCK SETOUT POINTS		
POINT A	NORTHING	EASTING
TW1	800303.770 mN	400038.153 mE
TW2	800303.271 mN	400035.923 mE
TW3	800304.122 mN	400033.887 mE



Rev	Description	Drawn	Checked	Designed	Design Checked	Approved	Date
1	FOR CONSTRUCTION	JXPP		CC			

Tab: MP-06-270
Scales: 1:100 (A3), 1:50 (A1)
Original Size: A1

Memorial Park Alliance

NZ TRANSPORT AGENCY
WAKA KOTAHU

Document Controller Check: _____ Date: _____
This drawing is not to be used for construction purposes unless signed approved and issued For Construction

SH1 WELLINGTON INNER CITY IMPROVEMENTS

MEMORIAL PARK - 05 WATER SUPPLY AREA 2 - DETAILS

BUCKLE STREET WEST WATER SUPPLY

Approved

Status: **FOR CONSTRUCTION**

Drawing Number: **MP-05-270** Revision: **1**